



TOP ACCESSORIES

Transformer bracket Cat. No 1703-X


5	R30	Ø49,0	
4	R30	Ø43,0	
3	R20	Ø31,0	
2	R20	Ø20,5	
1	R20	Ø12,5	
X	wym A	wym B	

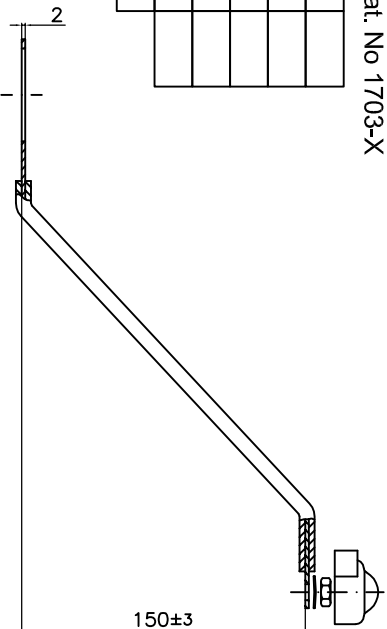

Scale 1:4

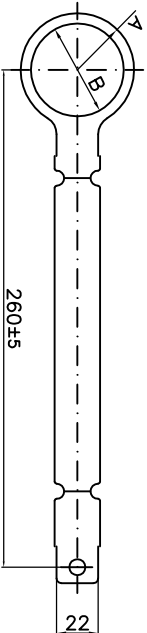


Transformer bracket Cat. No 1707
(for terminal nr. kat. MK1; MK2; MK3)

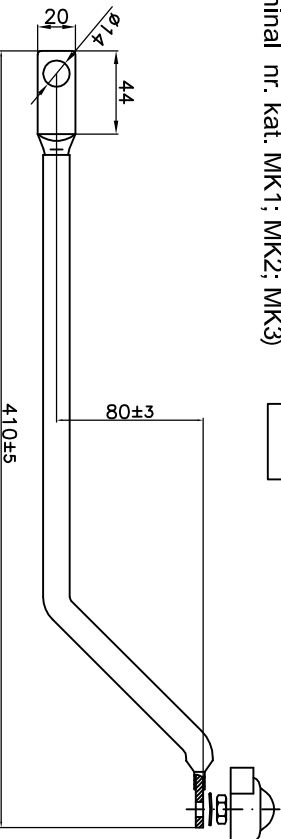


Scale 1:4

Transformer bracket Cat. No 1708
(for terminal Cat. No 33174600*)

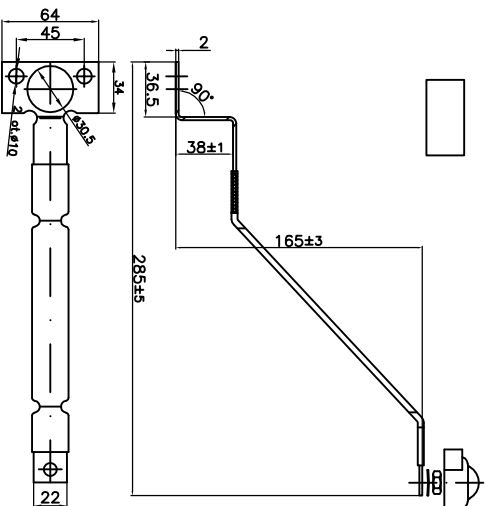

Scale 1:5

Transformer bracket Cat. No 1709
(for terminal Cat. No TOGA1; TOGA2; TOGA4)

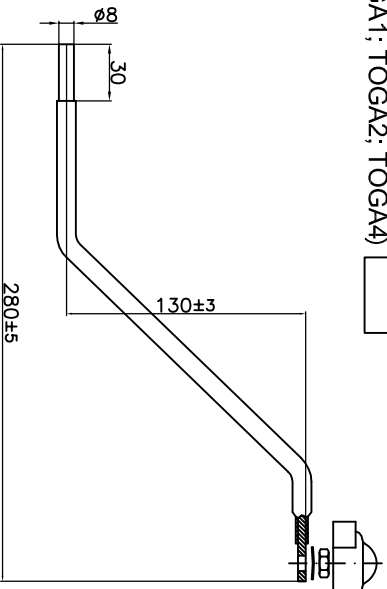

Scale 1:4

SURGE ARRESTER - LOVOS

I. Nominal discharge current In



5 kA	
10 kA	

II. Continuous operating voltage Uc

280V	
440V	
500V	
660V	


III. Disconnecting device

Yes	
No	

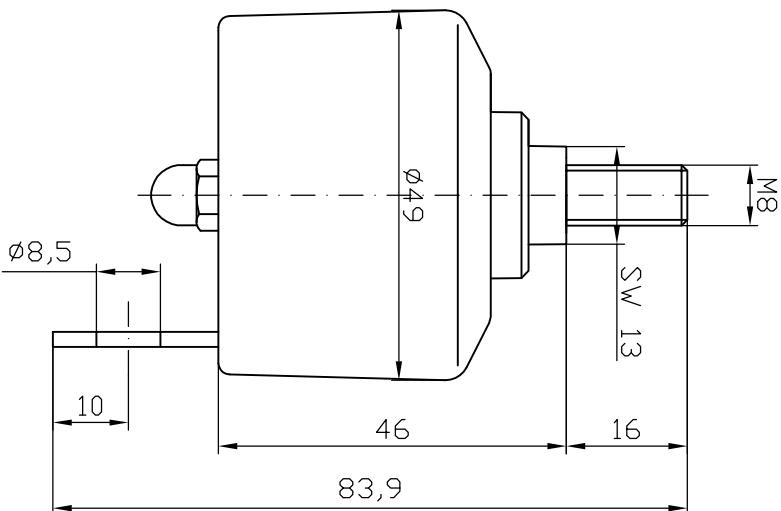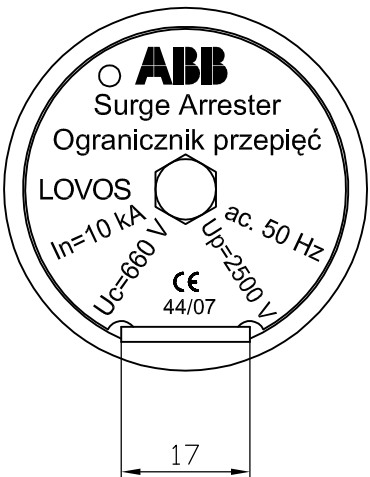


EARTH ACCESSORIES

Insulated cable Cu 16 mm² Cat. No 2721-1

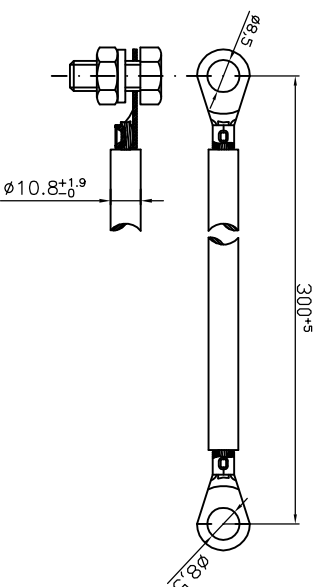


scale 1:2

Insulated cable Cu 16 mm² Cat. No 2721-2

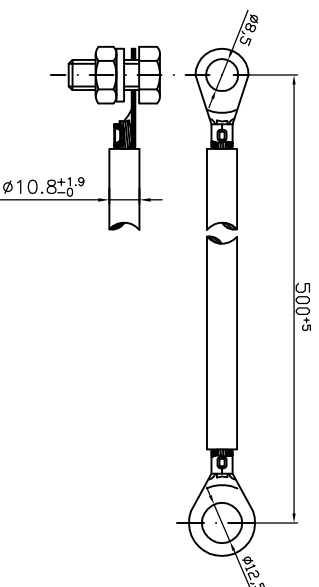

scale 1:2

SCHEME OF THE PROTECTION OF THE DISTRIBUTION TRANSFORMER ON THE SECONDARY SIDE

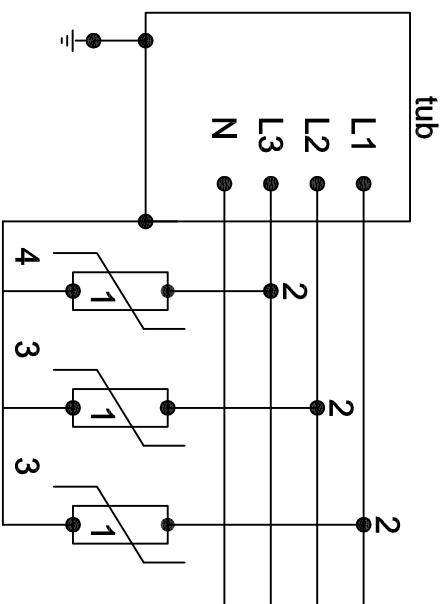

- 1 - Surge arrester
- 2 - Transformer bracket
- 3 - Insulated cable Cu 16 mm² Cat. No 2721-1
- 4 - Insulated cable Cu 16 mm² Cat. No 2721-2

Zastrzeżenie: niniejsze jest dokumentem i zawiera informacje, kopowanie, udzielenie i przekazywanie osobom trzecim bez zezwolenia surowo wzbronione. ABB Sp. z o.o. We reserve all rights in this document and in the information contained therein. Reproduction, use or disclosure to third parties without express authority is strictly forbidden. ABB Sp. z o.o. This document is issued by means of a computerized system. The digitally stored original is electronically approved. The approved document has a date entered in the "Approved" field. A manual signature is not required.



www.cablejoints.co.uk
THORNE & DERRICK UK
TEL 0044 191 490 1547 FAX 0044 477 5371
TEL 0044 117 977 4647 FAX 0044 977 5582
www.thorneandderrick.co.uk